


Region:	Trentino						Archetype code: CATR_ 1951-1960_F_TN	
Building category:	Catering buildings							
Period of construction:	1951-1960							
Climatic zone:	F	Number of records:				64		
Description (the codes associated with walls and slabs refer to the structures described in UNI/TR 11552:2014): External walls: no data available Roof slabs: no data available							Data sources: EPC databases (100%)	
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
BUILDING GEOMETRY	Number of floors	n_f	-	-	-	-	-	-
	Gross height	H_g	m	-	-	-	-	-
	Footprint area	$A_{\text{footprint}}$	m ²	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m ²	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m ²	194	217	88	120	201
	Heated gross volume	$V_{H,g}$	m ³	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m ³	775	852	354	502	797
	Compactness ratio	$A_{\text{env}}/V_{H,g}$	m ⁻¹	0.69	0.17	0.59	0.68	0.78
	WWR – North orientation	WWR_N	-	-	-	-	-	-
	WWR – South orientation	WWR_S	-	-	-	-	-	-
	WWR – East orientation	WWR_E	-	-	-	-	-	-
	WWR – West orientation	WWR_W	-	-	-	-	-	-
	Window to useful floor area ratio	A_{wi}/A_{use}	-	-	-	-	-	-
	ENVELOPE	Roof type	-					
U-value of the roof		$U_{\text{fl,up}}$	W/(m ² ·K)	-	-	-	-	-
External walls type		-						
U-value of the wall		U_{wl}	W/(m ² ·K)	-	-	-	-	-
Slab on ground floor type		-						
U-value of the floor		$U_{\text{fl,lw}}$	W/(m ² ·K)	-	-	-	-	-
Windows type		-						
U-value of the windows		U_{w}	W/(m ² ·K)	-	-	-	-	-
Shading system type		-						
GAINS and VENTILATION	Occupancy density *	O_c	person/m ²	UNI EN 16798-1 - Table A.19				
	Lighting power density *	W_L	W/m ²	UNI EN 16798-1 - A.8.3				
	Equipment power density *	W_A	W/m ²	UNI EN 16798-1 - A.8.3				
	Type of ventilation	Natural: 100%						
	Air exchange rate *	n	h ⁻¹	UNI EN 16798-1				
THERMAL SYSTEMS	Heating system type	Unknown 47%; Autonomous: 34%; Centralized: 19%						
	Heating generator	Boiler (unknown type): 91%; Unknown: 5%; Air-source heat pump: 2%; Fireplace: 2%						
	Daily operating time of the heating system *	t_H	h	No limitation				
	Energy carrier	Natural gas: 46%, Gas oil: 30%; Solid biomass: 13%; LPG: 9%; Electricity: 2%						
	Heating emission sub-system	-						
	Cooling system type	Unknown: 95%; Air-cooled chiller: 5%						
	Daily operating time of the cooling system *	t_C	h	No limitation				
	Cooling emission sub-system	-						
	DHW system type	Autonomous – coupled with heating: 42%; Unknown: 27%; Autonomous - detached from heating: 19%; Centralized – coupled with heating: 9%; District heating: 3%						
	DHW generator	Natural gas boiler: 63%; Electric Heat Pump: 19%; Unknown 9%; Electric boiler: 9%						
* These values were not available in the considered sources, and are thus derived from UNI EN Standards								


Region:	Trentino	Archetype code: CATR_ 1951-1960_F_TN
Building category:	Catering buildings	
Period of construction:	1951-1960	
Climatic zone:	F	
Number of records:		64

Numerical variables – GEOMETRY

COMPACTNESS RATIO

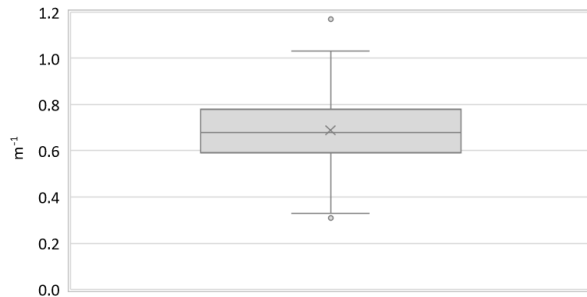


WINDOWS TO WALL RATIO

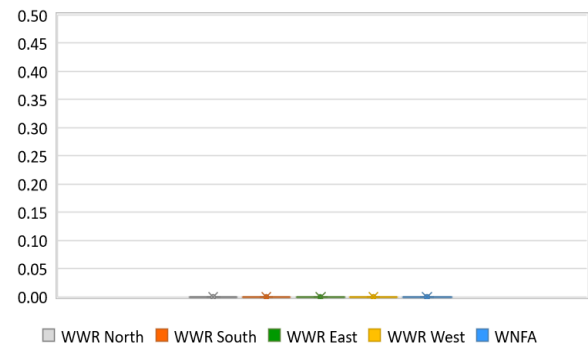


Numerical variables – ENVELOPE

OPAQUE BUILDING COMPONENTS U-VALUE

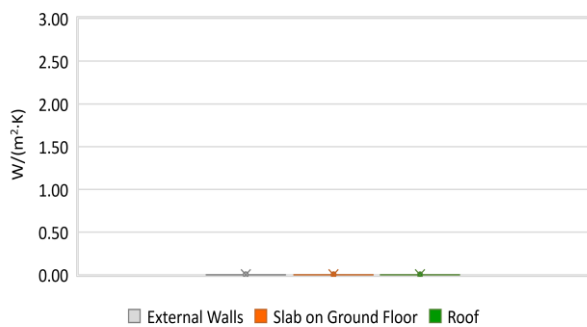


WINDOWS U-VALUE

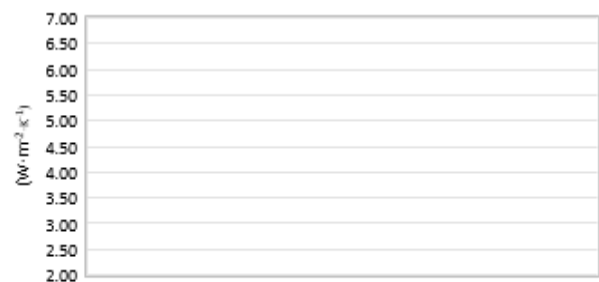

Numerical variables – GAINS, VENTILATION and SYSTEMS USAGE


AIR EXCHANGE RATE

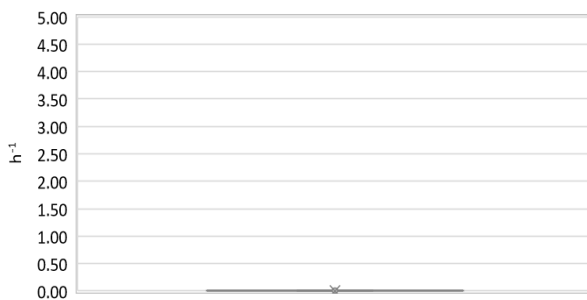


OCCUPANCY DENSITY



INTERNAL GAINS POWER DENSITY

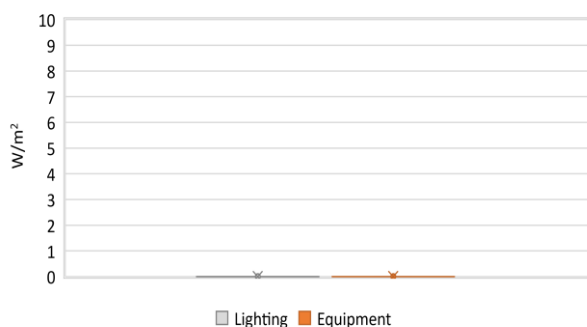


DAILY OPERATING TIME

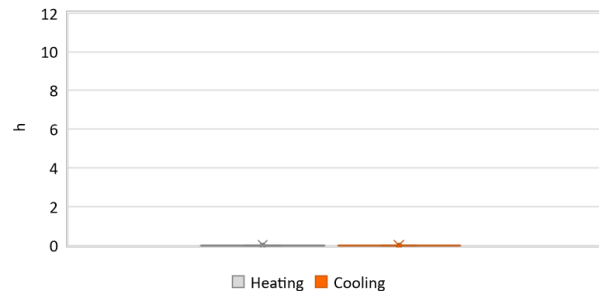

Region:	Trentino	Archetype code: CATR_ 1951-1960_F_TN
Building category:	Catering buildings	
Period of construction:	1951-1960	
Climatic zone:	F	
Number of records:		64

ADDITIONAL DATA								
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
THERMAL SYSTEMS	Heating efficiency or <i>COP</i>	$\eta_{H,gen}$ or $COP_{H,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total heating power *	$P_{H,gen}$	kW	63	108	24	29	49
	Cooling efficiency or <i>EER</i>	$\eta_{C,gen}$ or $EER_{C,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total cooling power *	$P_{C,gen}$	kW	17	7	13	15	18
	Temperature of DHW	ϑ_W	°C	40	-	40	40	40
	DHW system power *	$P_{W,gen}$	kW	35	38	19	26	34

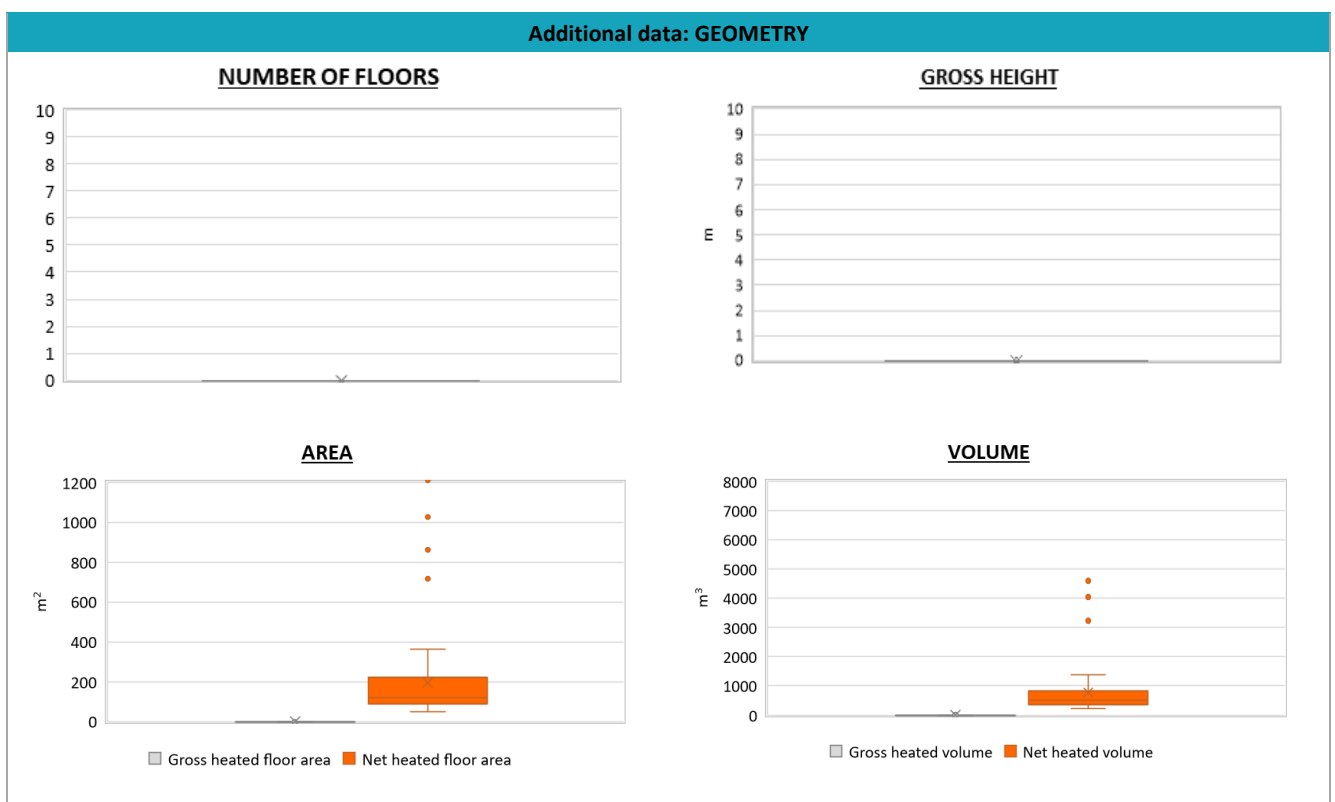



Region:	Trentino	Archetype code: CATR_ 1951-1960_F_TN
Building category:	Catering buildings	
Period of construction:	1951-1960	
Climatic zone:	F	
Number of records:		64

Additional data: other numerical variables that are not included in the archetype


DHW SUPPLY TEMPERATURE




SYSTEM POWER

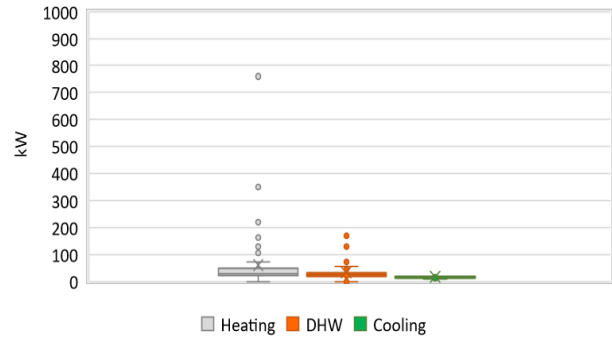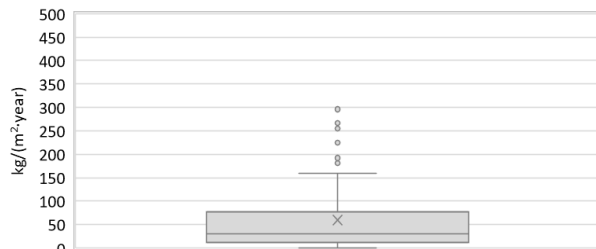
CO₂ EMISSION


HEATING SYSTEM INSTALLATION YEAR

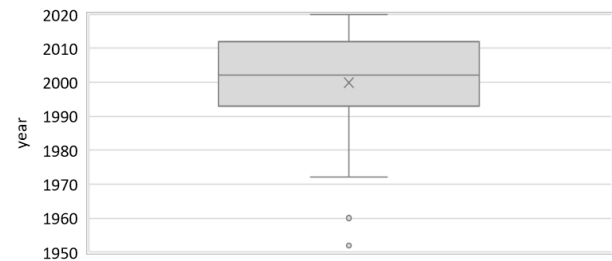

NON-RENEWABLE PRIMARY ENERGY USE

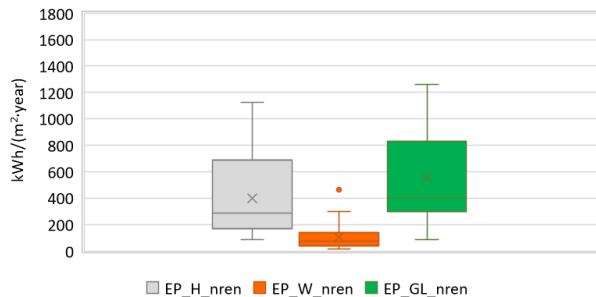

RENEWABLE PRIMARY ENERGY USE

