



Region:	Trentino Alto Adige						Archetype code: RES_APPBLOCK_ 1931-1940_E_TN	
Building category:	Residential buildings – Apartments (in multifamily blocks)							
Period of construction:	1931-1940							
Climatic zone:	E	Number of records:				223		
Description (the codes associated with walls and slabs refer to the structures described in UNI/TR 11552:2014): External walls: no data available Roof slabs: no data available							Data sources: APE (100%)	
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
BUILDING GEOMETRY	Number of floors	n_f	-	-	-	-	-	-
	Gross height	H_g	m	-	-	-	-	-
	Footprint area	$A_{\text{footprint}}$	m ²	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m ²	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m ²	645	438	336	356	809
	Heated gross volume	$V_{H,g}$	m ³	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m ³	2389	1398	1402	1471	2918
	Compactness ratio	$A_{\text{env}}/V_{H,g}$	m ⁻¹	0.56	0.08	0.45	0.57	0.65
	WWR – North orientation	WWR_N	-	-	-	-	-	-
	WWR – South orientation	WWR_S	-	-	-	-	-	-
	WWR – East orientation	WWR_E	-	-	-	-	-	-
	WWR – West orientation	WWR_W	-	-	-	-	-	-
	Window to useful floor area ratio	A_{wi}/A_{use}	-	-	-	-	-	-
ENVELOPE	Roof type	-						
	U-value of the roof	$U_{fi;up}$	W/(m ² ·K)	-	-	-	-	-
	External walls type	-						
	U-value of the wall	U_{wl}	W/(m ² ·K)	-	-	-	-	-
	Slab on ground floor type	-						
	U-value of the floor	$U_{fi;lw}$	W/(m ² ·K)	-	-	-	-	-
	Windows type	-						
	U-value of the windows	U_W	W/(m ² ·K)	-	-	-	-	-
Shading system type	-							
GAINS and VENTILATION	Occupancy density *	O_c	person/m ²	UNI EN 16798-1 - Table A.19				
	Lighting power density *	W_L	W/m ²	UNI EN 16798-1 - A.8.3				
	Equipment power density *	W_A	W/m ²	UNI EN 16798-1 - A.8.3				
	Type of ventilation	Natural: 100%						
	Air exchange rate *	n	h ⁻¹	0.30	-	0.30	0.30	0.30
THERMAL SYSTEMS	Heating system type	Autonomous: 67%, Centralized: 13%, Unknown: 20%						
	Heating generator	Boiler (Unknown type): 80%, Condensing boiler: 6%, Traditional boiler: 5%, Unknown: 4%, Air source heat pump: 3%, DHC:1%, Fireplace: 1%						
	Daily operating time of the heating system *	t_H	h	14	-	14	14	14
	Energy carrier	Natural gas: 95%, LPG: 2%, Solid biomass:1%, Gas Oil: 1%, Electricity: 1%						
	Heating emission sub-system	-						
	Cooling system type	Unknown: 99%, Air-cooled chiller: 1%						
	Daily operating time of the cooling system *	t_C	h	-	-	-	-	-
	Cooling emission sub-system	-						
	DHW system type	Autonomous – coupled with heating: 61%, Unknown: 23% Autonomous - detached from heating: 10%, Centralized – coupled with heating: 5%, DHC: 1%						
	DHW generator	Natural gas boiler: 66%, Unknown: 24%, Electric Heat Pump: 9%, Electric boiler: 1%						
* These values were not available in the considered sources, and are thus derived from UNI EN Standards								

Region:	Trentino Alto Adige	Archetype code: RES_APPBLOCK_ 1931-1940_E_TN
Building category:	Residential buildings – Apartments (in multifamily blocks)	
Period of construction:	1931-1940	
Climatic zone:	E	
Number of records: 223		


Numerical variables – GEOMETRY

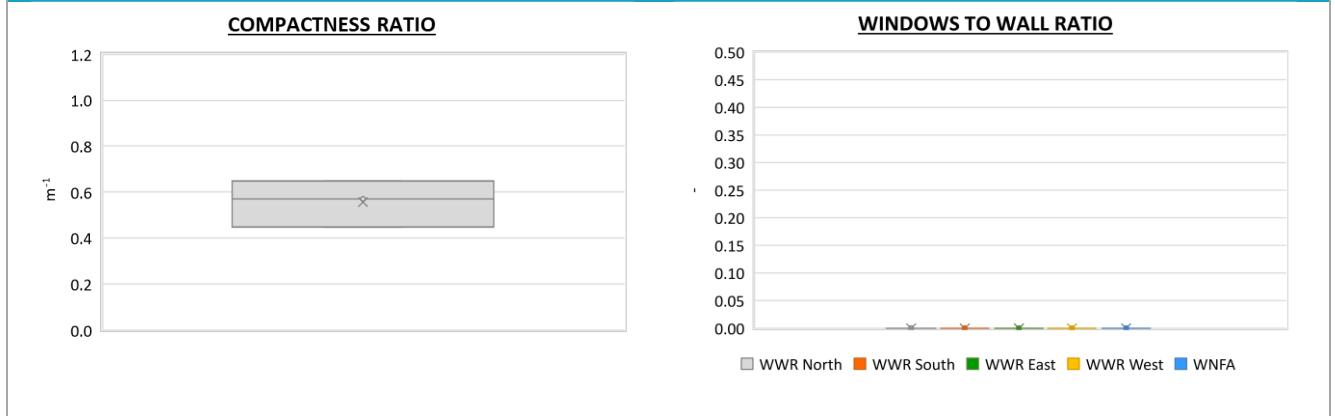

Numerical variables – ENVELOPE

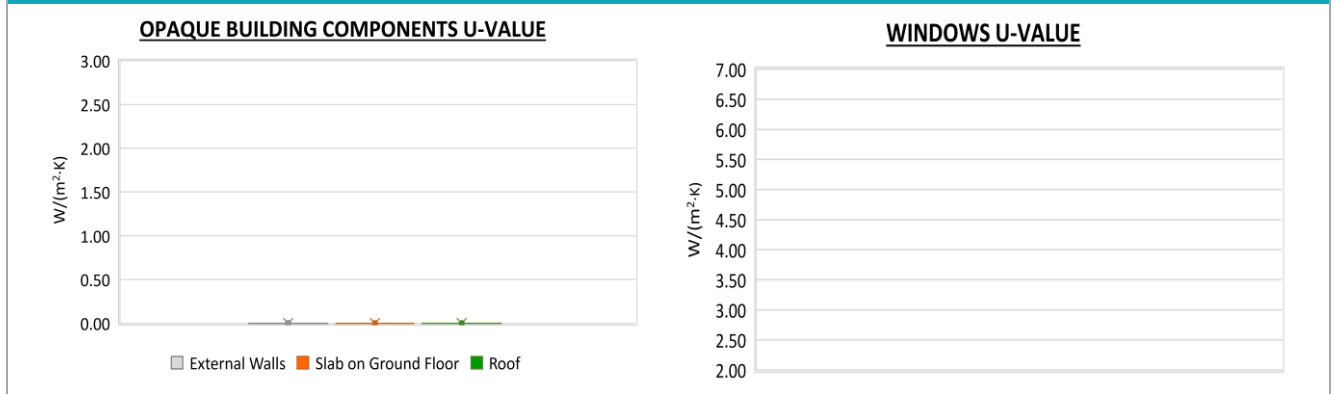

Numerical variables – GAINS, VENTILATION and SYSTEMS USAGE

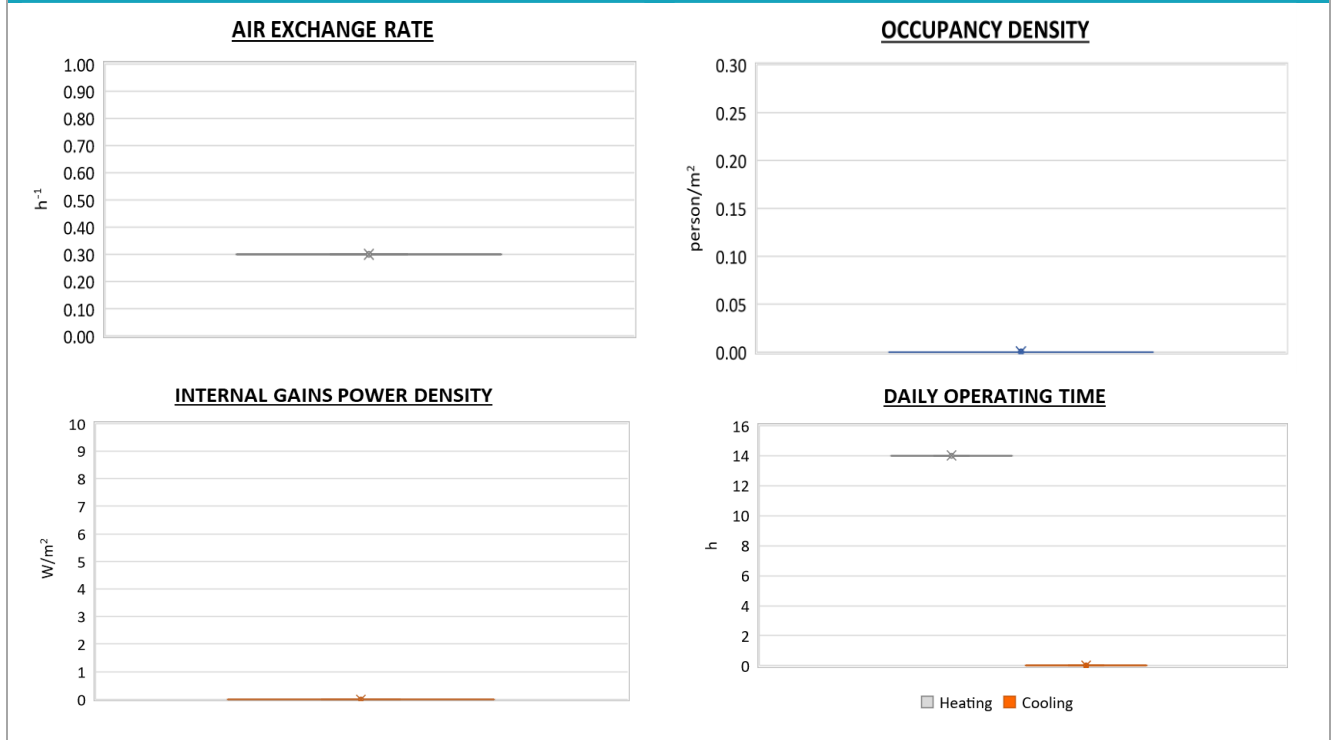

The data can be used for analysis, modeling, and research purposes, as long as it remains unaltered in its original form. Users are free to publish results based on the data, provided they credit the original source.

Region:	Trentino Alto Adige			Archetype code: RES_APPBLOCK_ 1931-1940_E_TN
Building category:	Residential buildings – Apartments (in multifamily blocks)			
Period of construction:	1931-1940			
Climatic zone:	E	Number of records:	223	

ADDITIONAL DATA								
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
GEOMETRY: apartments	Inter-storey height	H_n	m	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m ²	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m ²	86	35	62	76	98
	Heated gross volume	$V_{H,g}$	m ³	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m ³	360	153	258	332	422
THERMAL SYSTEMS	Heating efficiency or <i>COP</i>	$\eta_{H,gen}$ or $COP_{H,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total heating power *	$P_{H,gen}$	kW	29	20	24	25	29
	Cooling efficiency or <i>EER</i>	$\eta_{C,gen}$ or $EER_{C,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total cooling power *	$P_{C,gen}$	kW	24	30	7	8	25
	Temperature of DHW	ϑ_W	°C	40	-	40	40	40
	DHW system power *	$P_{W,gen}$	kW	29	20	24	25	29

* These values refer to the apartment scale

Additional data: GEOMETRY (the plots refer to the apartment scale)




Region:	Trentino Alto Adige	Archetype code: RES_APPBLOCK_ 1931-1940_E_TN
Building category:	Residential buildings – Apartments (in multifamily blocks)	
Period of construction:	1931-1940	
Climatic zone:	E	
Number of records: 223		

Additional data: other numerical variables that are not included in the archetype


DHW SUPPLY TEMPERATURE




SYSTEM POWER

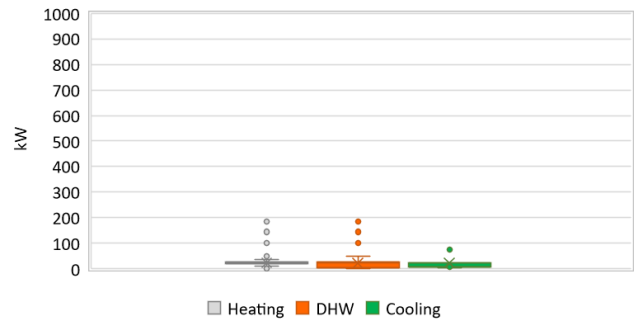


CO₂ EMISSION

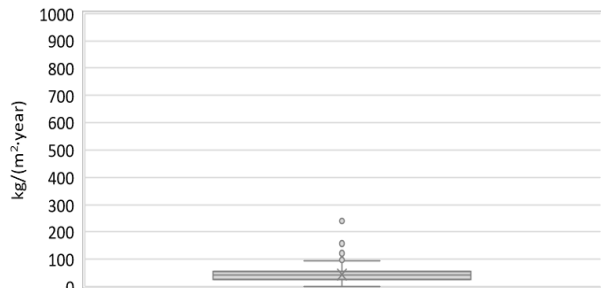

HEATING SYSTEM INSTALLATION YEAR

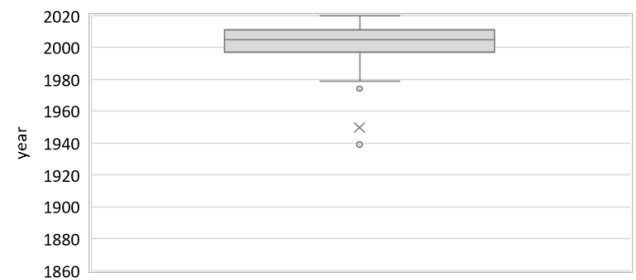

NON-RENEWABLE PRIMARY ENERGY USE

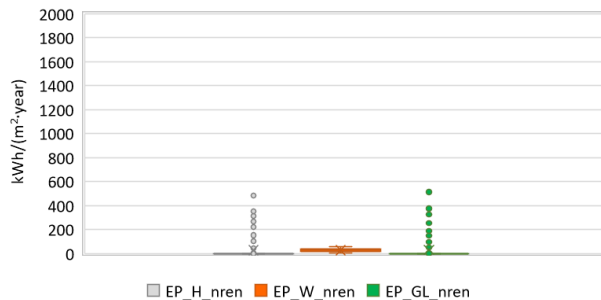

RENEWABLE PRIMARY ENERGY USE

