


Region:	Trentino						Archetype code: RES_SINGLE_ 1951-1960_F_TN	
Building category:	Residential single buildings							
Period of construction:	1951-1960							
Climatic zone:	F	Number of records:		1348				
Description (the codes associated with walls and slabs refer to the structures described in UNI/TR 11552:2014): External walls: no data available Roof slabs: no data available							Data sources: EPC databases (100%)	
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
BUILDING GEOMETRY	Number of floors	n_f	-	-	-	-	-	-
	Gross height	H_g	m	-	-	-	-	-
	Footprint area	$A_{\text{footprint}}$	m ²	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m ²	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m ²	107	86	67	86	110
	Heated gross volume	$V_{H,g}$	m ³	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m ³	430	623	256	331	433
	Compactness ratio	$A_{\text{env}}/V_{H,g}$	m ⁻¹	0.69	0.20	0.56	0.70	0.81
	WWR – North orientation	WWR_N	-	-	-	-	-	-
	WWR – South orientation	WWR_S	-	-	-	-	-	-
	WWR – East orientation	WWR_E	-	-	-	-	-	-
	WWR – West orientation	WWR_W	-	-	-	-	-	-
	Window to useful floor area ratio	A_{wi}/A_{use}	-	-	-	-	-	-
	ENVELOPE	Roof type	-					
U-value of the roof		$U_{f,up}$	W/(m ² ·K)	-	-	-	-	-
External walls type		-						
U-value of the wall		U_{wl}	W/(m ² ·K)	-	-	-	-	-
Slab on ground floor type		-						
U-value of the floor		$U_{f,lw}$	W/(m ² ·K)	-	-	-	-	-
Windows type		-						
U-value of the windows		U_W	W/(m ² ·K)	-	-	-	-	-
Shading system type		-						
GAINS and VENTILATION	Occupancy density *	O_C	person/m ²	UNI EN 16798-1				
	Lighting power density *	W_L	W/m ²	UNI EN 16798-1				
	Equipment power density *	W_A	W/m ²	UNI EN 16798-1				
	Type of ventilation	Natural: 100%						
	Air exchange rate *	n	h ⁻¹	0.3	-	0.3	0.3	0.3
THERMAL SYSTEMS	Heating system type	Unknown 72%; Centralized: 14%; Autonomous: 14%						
	Heating generator	Boiler (unknown type): 98%; Air-source heat pump: 1%; Fireplace: 1%						
	Daily operating time of the heating system *	t_H	h	No limitation				
	Energy carrier	District heating: 59%; Electricity: 35%; Electricity from PV, wind turbines, hydraulic turbines: 5%; District cooling: 1%						
	Heating emission sub-system	-						
	Cooling system type	Unknown: 100%						
	Daily operating time of the cooling system *	t_C	h	No limitation				
	Cooling emission sub-system	-						
	DHW system type	Unknown: 44%; Autonomous – coupled with heating: 28%; Autonomous - detached from heating: 15%; Centralized – coupled with heating: 8%; District heating: 5%						
	DHW generator	Natural gas boiler: 45%; Unknown 24%; Electric boiler: 19%; Electric heat pump: 11%; Solar thermal: 1%						
	* These values were not available in the considered sources, and are thus derived from UNI EN Standards							


Region:	Trentino	Archetype code: RES_SINGLE_ 1951-1960_F_TN
Building category:	Residential single buildings	
Period of construction:	1951-1960	
Climatic zone:	F	
Number of records:		1348

Numerical variables – GEOMETRY

COMPACTNESS RATIO

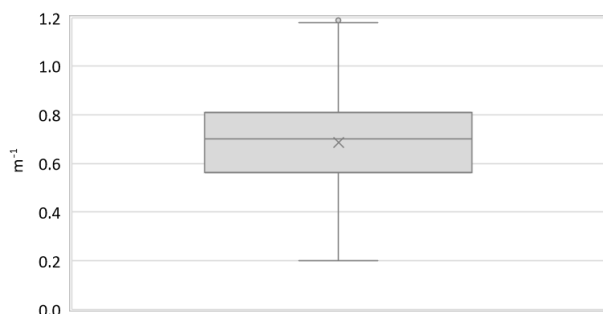


WINDOWS TO WALL RATIO

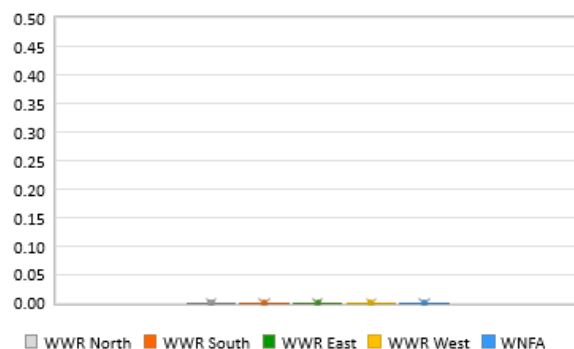


Numerical variables – ENVELOPE

OPAQUE BUILDING COMPONENTS U-VALUE

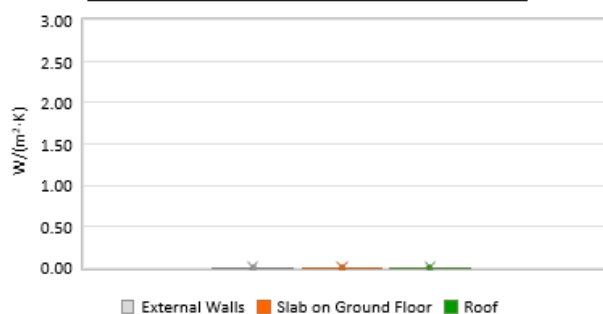

WINDOWS U-VALUE

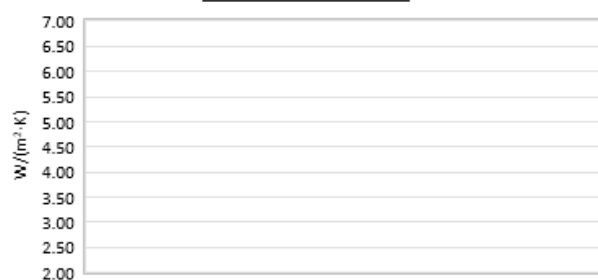

Numerical variables – GAINS, VENTILATION and SYSTEMS USAGE

AIR EXCHANGE RATE




OCCUPANCY DENSITY



INTERNAL GAINS POWER DENSITY




DAILY OPERATING TIME

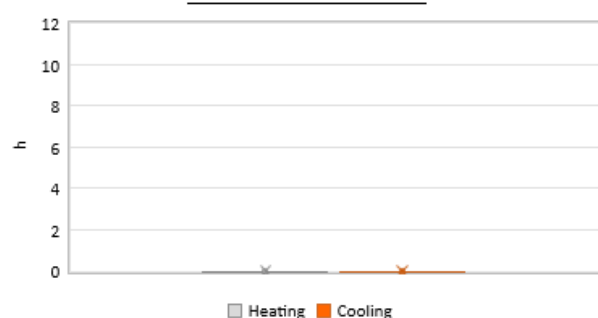

The data can be used for analysis, modeling, and research purposes, as long as it remains unaltered in its original form. Users are free to publish results based on the data, provided they credit the original source.

Region:	Trentino			Archetype code: RES_SINGLE_ 1951-1960_F_TN
Building category:	Residential single buildings			
Period of construction:	1951-1960			
Climatic zone:	F	Number of records:	1348	

ADDITIONAL DATA								
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
THERMAL SYSTEMS	Heating efficiency or <i>COP</i>	$\eta_{H,gen}$ or $COP_{H,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total heating power *	$P_{H,gen}$	kW	42	158	24	27	33
	Cooling efficiency or <i>EER</i>	$\eta_{C,gen}$ or $EER_{C,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total cooling power *	$P_{C,gen}$	kW	11	10	6	7	7
	Temperature of DHW	ϑ_W	°C	40	-	40	40	40
	DHW system power *	$P_{W,gen}$	kW	38	145	22	25	32

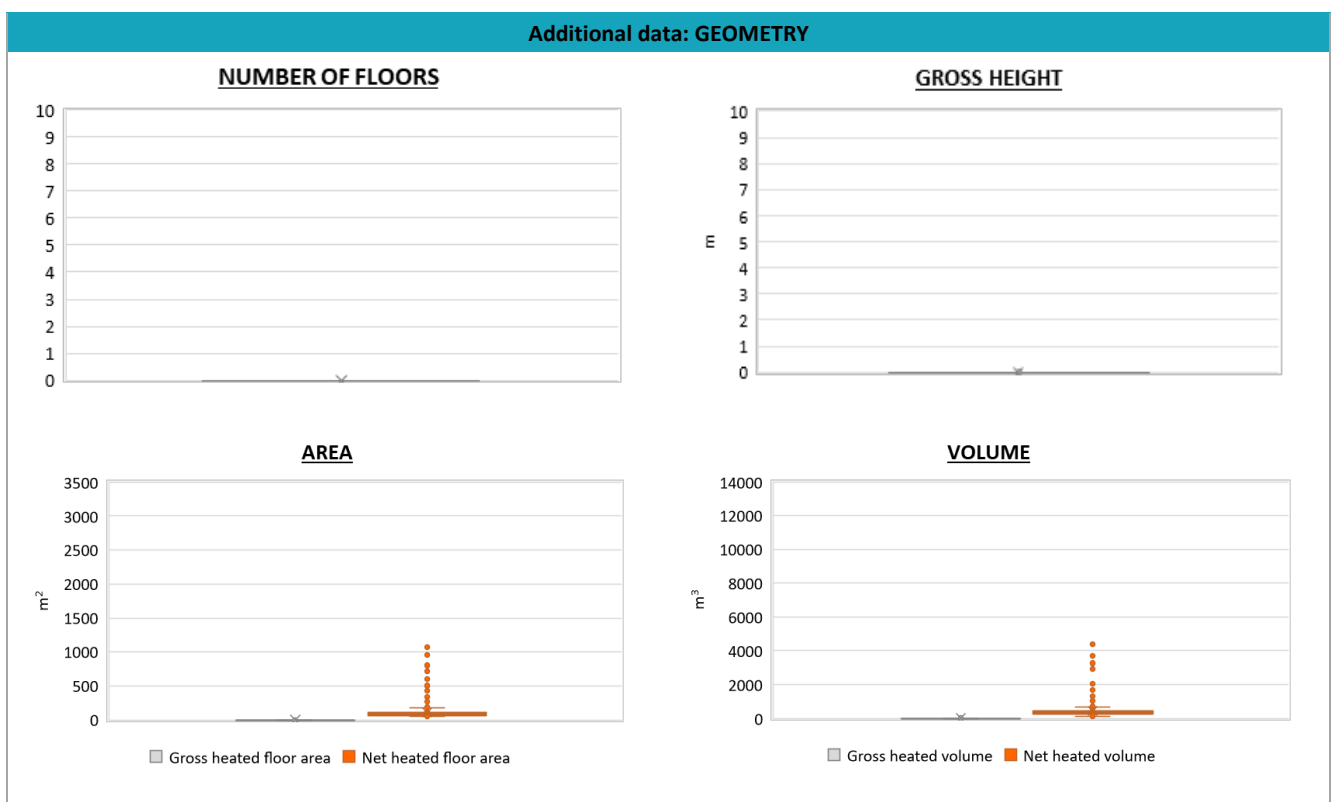


Region:	Trentino	Archetype code: RES_SINGLE_ 1951-1960_F_TN
Building category:	Residential single buildings	
Period of construction:	1951-1960	
Climatic zone:	F	
Number of records:		1348

Additional data: other numerical variables that are not included in the archetype


DHW SUPPLY TEMPERATURE




SYSTEM POWER

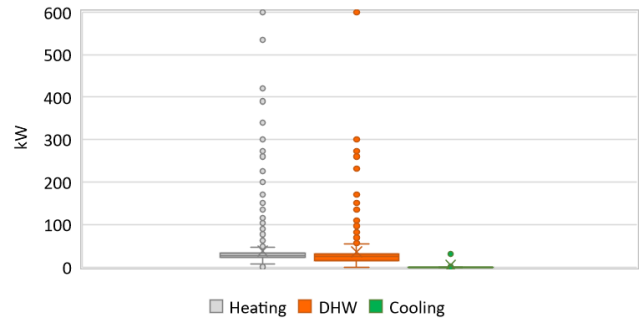


CO₂ EMISSION

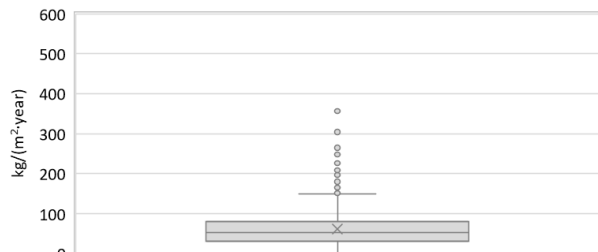

HEATING SYSTEM INSTALLATION YEAR

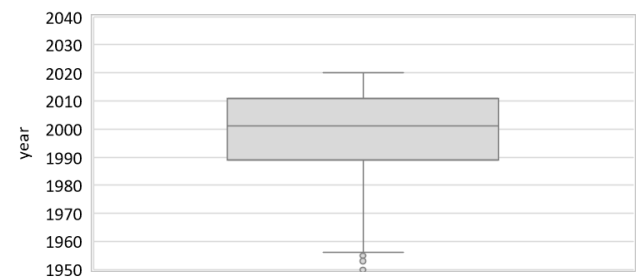

NON-RENEWABLE PRIMARY ENERGY USE

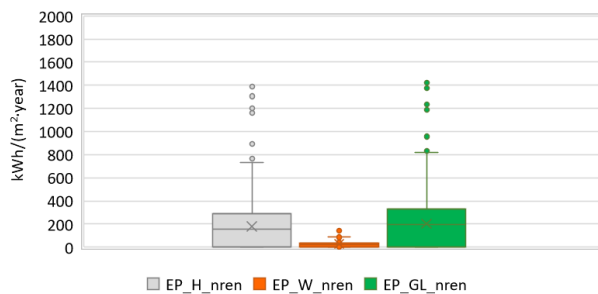

RENEWABLE PRIMARY ENERGY USE

