


Region:	Trentino Alto Adige						Archetype code: COMM_2001-2010_E_TN	
Building category:	Commercial buildings							
Period of construction:	2001-2010							
Climatic zone:	E	Number of records:				350		
Description (the codes associated with walls and slabs refer to the structures described in UNI/TR 11552:2014): External walls: no data available Roof slabs: no data available							Data sources: APE (100%)	
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
BUILDING GEOMETRY	Number of floors	$n_f$	-	-	-	-	-	-
	Gross height	$H_g$	m	-	-	-	-	-
	Footprint area	$A_{\text{footprint}}$	m <sup>2</sup>	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m <sup>2</sup>	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m <sup>2</sup>	446	897	90	149	396
	Heated gross volume	$V_{H,g}$	m <sup>3</sup>	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m <sup>3</sup>	2327	7341	381	644	2129
	Compactness ratio	$A_{\text{env}}/V_{H,g}$	m <sup>-1</sup>	0.55	0.19	0.39	0.53	0.65
	WWR – North orientation	$WWR_N$	-	-	-	-	-	-
	WWR – South orientation	$WWR_S$	-	-	-	-	-	-
	WWR – East orientation	$WWR_E$	-	-	-	-	-	-
	WWR – West orientation	$WWR_W$	-	-	-	-	-	-
	Window to useful floor area ratio	$A_{wi}/A_{\text{use}}$	-	-	-	-	-	-
ENVELOPE	Roof type	-						
	U-value of the roof	$U_{fi,up}$	W/(m <sup>2</sup> ·K)	-	-	-	-	-
	External walls type	-						
	U-value of the wall	$U_{wl}$	W/(m <sup>2</sup> ·K)	-	-	-	-	-
	Slab on ground floor type	-						
	U-value of the floor	$U_{fi,lw}$	W/(m <sup>2</sup> ·K)	-	-	-	-	-
	Windows type	-						
	U-value of the windows	$U_W$	W/(m <sup>2</sup> ·K)	-	-	-	-	-
Shading system type	-							
GAINS and VENTILATION	Occupancy density *	$O_c$	person/m <sup>2</sup>	UNI EN 16798-1 - Table A.19				
	Lighting power density *	$W_L$	W/m <sup>2</sup>	UNI EN 16798-1 - A.8.3				
	Equipment power density *	$W_A$	W/m <sup>2</sup>	UNI EN 16798-1 - A.8.3				
	Type of ventilation	Natural: 100%						
	Air exchange rate *	$n$	h <sup>-1</sup>	UNI EN 16798-1				
THERMAL SYSTEMS	Heating system type	Unknown: 48%, Centralized: 27%, Autonomous: 25%						
	Heating generator	Boiler (Unknown type): 48%, Traditional boiler: 19%; Air source heat pump: 13%, Condensing boiler: 13%, DHC: 4%, Unknown: 4%						
	Daily operating time of the heating system *	$t_H$	h	14	-	14	14	14
	Energy carrier	Natural gas: 84%, Electricity: 12%, District heating: 1%, Gas Oil: 1%, Electricity from PV, wind turbines, hydraulic turbines: 1%, LPG: 1%						
	Heating emission sub-system	-						
	Cooling system type	Unknown: 81%, Air-cooled chiller: 19%						
	Daily operating time of the cooling system *	$t_C$	h	-	-	-	-	-
	Cooling emission sub-system	-						
	DHW system type	Autonomous - detached from heating: 41%, Unknown: 28%, Autonomous – coupled with heating: 21%, Centralized – coupled with heating: 9%, District heating: 1%						
	DHW generator	Natural gas boiler: 30%, Unknown: 29%, Electric heat pump: 24%, Electric boiler:17%						
* These values were not available in the considered sources, and are thus derived from UNI EN Standards								

Region:	Trentino Alto Adige			Archetype code: COMM_2001-2010_E_TN
Building category:	Commercial buildings			
Period of construction:	2001-2010			
Climatic zone:	E	Number of records:	350	

### Numerical variables – GEOMETRY

**COMPACTNESS RATIO**

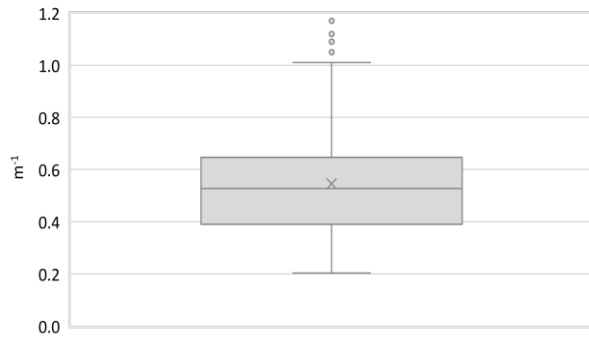


**WINDOWS TO WALL RATIO**



### Numerical variables – ENVELOPE

**OPAQUE BUILDING COMPONENTS U-VALUE**

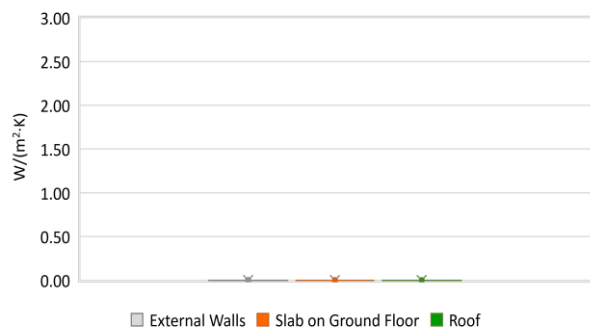


**WINDOWS U-VALUE**



### Numerical variables – GAINS, VENTILATION and SYSTEMS USAGE


**AIR EXCHANGE RATE**

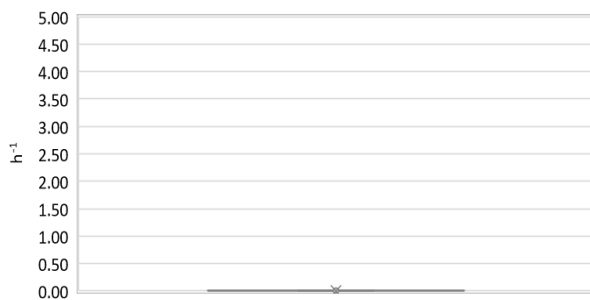


**OCCUPANCY DENSITY**



**INTERNAL GAINS POWER DENSITY**

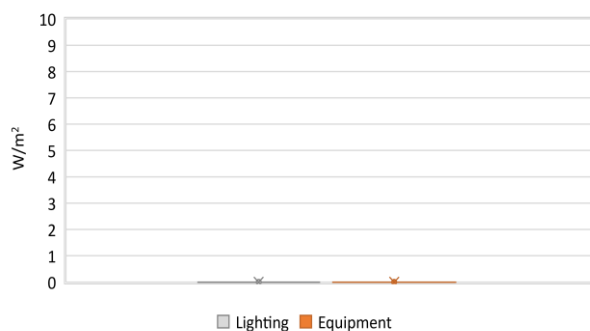


**DAILY OPERATING TIME**

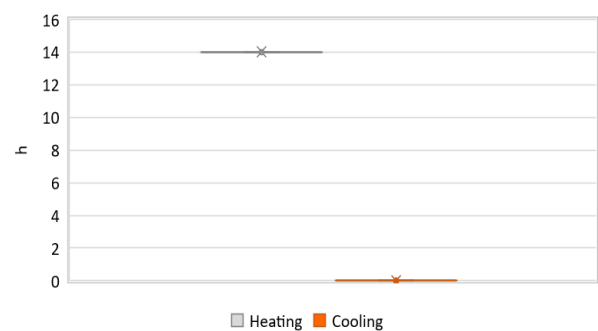

The data can be used for analysis, modeling, and research purposes, as long as it remains unaltered in its original form. Users are free to publish results based on the data, provided they credit the original source.

Region:	Trentino Alto Adige			Archetype code: COMM_2001-2010_E_TN
Building category:	Commercial buildings			
Period of construction:	2001-2010			
Climatic zone:	E	Number of records:	350	

ADDITIONAL DATA								
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
THERMAL SYSTEMS	Heating efficiency or <i>COP</i>	$\eta_{H,gen}$ or $COP_{H,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total heating power	$P_{H,gen}$	kW	128	215	25	32	150
	Cooling efficiency or <i>EER</i>	$\eta_{C,gen}$ or $EER_{C,gen}$	-	This value has to be retrieved from suitable datasheets				
	Total cooling power	$P_{C,gen}$	kW	221	285	13	70	372
	Temperature of DHW	$\vartheta_W$	°C	40	-	40	40	40
	DHW system power	$P_{W,gen}$	kW	-	-	-	-	-

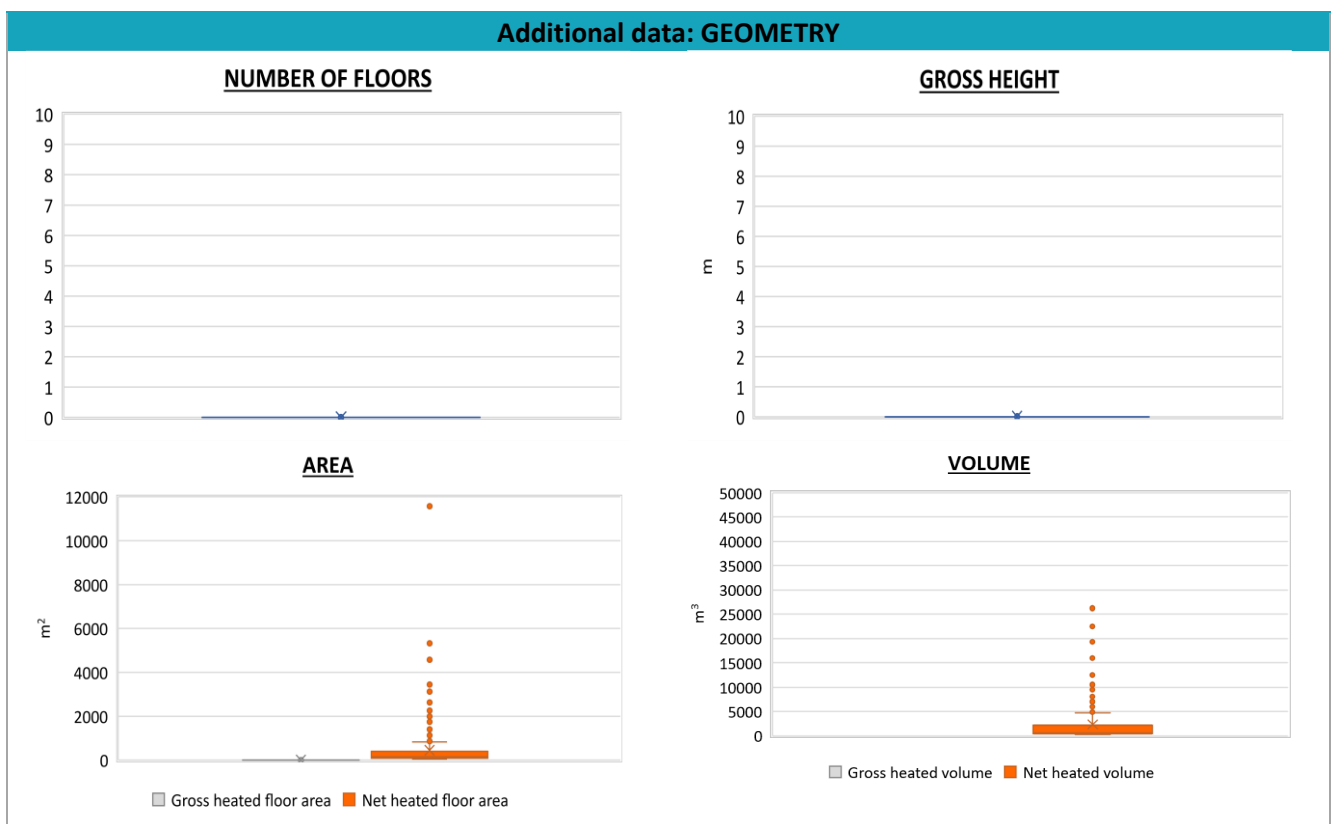

Region:	Trentino Alto Adige	Archetype code: COMM_2001-2010_E_TN
Building category:	Commercial buildings	
Period of construction:	2001-2010	
Climatic zone:	E	
Number of records:		350

### Additional data: other numerical variables that are not included in the archetype

