

Region:	Trentino						Archetype code: RES_TEMP_ -1930_F_TN	
Building category:	Temporary residential buildings							
Period of construction:	<1930							
Climatic zone:	F	Number of records:				122		
Description (the codes associated with walls and slabs refer to the structures described in UNI/TR 11552:2014): External walls: no data available Roof slabs: no data available							Data sources: EPC databases (100%)	
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
BUILDING GEOMETRY	Number of floors	n_f	-	-	-	-	-	-
	Gross height	H_g	m	-	-	-	-	-
	Footprint area	$A_{\text{footprint}}$	m ²	-	-	-	-	-
	Heated gross floor area	$A_{H,g}$	m ²	-	-	-	-	-
	Heated net floor area	$A_{H,n}$	m ²	1089	1377	319	720	1226
	Heated gross volume	$V_{H,g}$	m ³	-	-	-	-	-
	Heated net volume	$V_{H,n}$	m ³	4486	5756	1113	2796	5660
	Compactness ratio	$A_{\text{env}}/V_{H,g}$	m ⁻¹	0.54	0.17	0.42	0.51	0.62
	WWR – North orientation	WWR_N	-	-	-	-	-	-
	WWR – South orientation	WWR_S	-	-	-	-	-	-
	WWR – East orientation	WWR_E	-	-	-	-	-	-
	WWR – West orientation	WWR_W	-	-	-	-	-	-
	Window to useful floor area ratio	A_{wi}/A_{use}	-	-	-	-	-	-
	ENVELOPE	Roof type	-					
U-value of the roof		$U_{fi,up}$	W/(m ² ·K)	-	-	-	-	-
External walls type		-						
U-value of the wall		U_{wl}	W/(m ² ·K)	-	-	-	-	-
Slab on ground floor type		-						
U-value of the floor		$U_{fi,lw}$	W/(m ² ·K)	-	-	-	-	-
Windows type		-						
U-value of the windows		U_W	W/(m ² ·K)	-	-	-	-	-
Shading system type		-						
GAINS and VENTILATION	Occupancy density *	O_c	person/m ²	UNI EN 16798-1				
	Lighting power density *	W_L	W/m ²	UNI EN 16798-1				
	Equipment power density *	W_A	W/m ²	UNI EN 16798-1				
	Type of ventilation	Natural: 100%						
	Air exchange rate *	n	h ⁻¹	0.3	-	0.3	0.3	0.3
THERMAL SYSTEMS	Heating system type	Unknown: 52%; Centralized: 32%; Autonomous: 16%						
	Heating generator	Boiler (unknown type): 84%; Unknown: 10%; Heat exchanger of district heating/cooling: 4%; Air-source heat pump: 2%						
	Daily operating time of the heating system *	t_H	h	No limitation				
	Energy carrier	Gas oil: 34%; Natural gas 28%; Solid biomass: 22%; LPG: 8%; District heating: 4%; Electricity: 3%; Electricity from PV, wind turbines, hydraulic turbines: 1%						
	Heating emission sub-system	-						
	Cooling system type	Unknown: 94%, Air-cooled chiller: 6%						
	Daily operating time of the cooling system *	t_c	h	No limitation				
	Cooling emission sub-system	-						
	DHW system type	Unknown: 33%; Centralized – coupled with heating: 29%; Autonomous – coupled with heating: 26%; District heating: 7%; Autonomous - detached from heating: 5%						
	DHW generator	Natural gas boiler: 75%; Unknown: 15%; Electric Heat Pump: 5%; Electric boiler: 3%; Solar thermal: 2%						
* These values were not available in the considered sources, and are thus derived from UNI EN Standards								




The data can be used for analysis, modeling, and research purposes, as long as it remains unaltered in its original form. Users are free to publish results based on the data, provided they credit the original source.

Region:	Trentino	Archetype code: RES_TEMP_ -1930_F_TN
Building category:	Temporary residential buildings	
Period of construction:	<1930	
Climatic zone:	F	
Number of records:		122


Numerical variables – GEOMETRY



Numerical variables – ENVELOPE

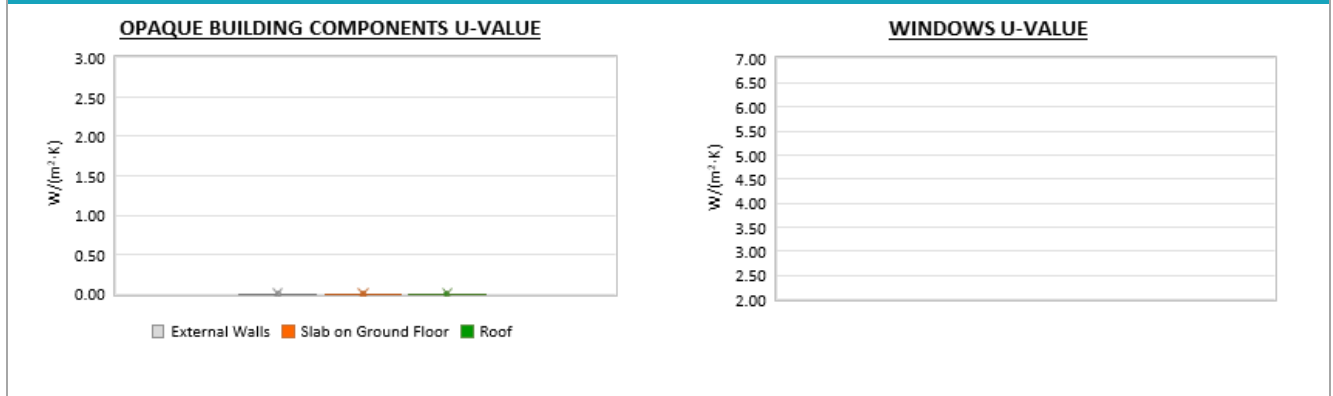


Numerical variables – GAINS, VENTILATION and SYSTEMS USAGE

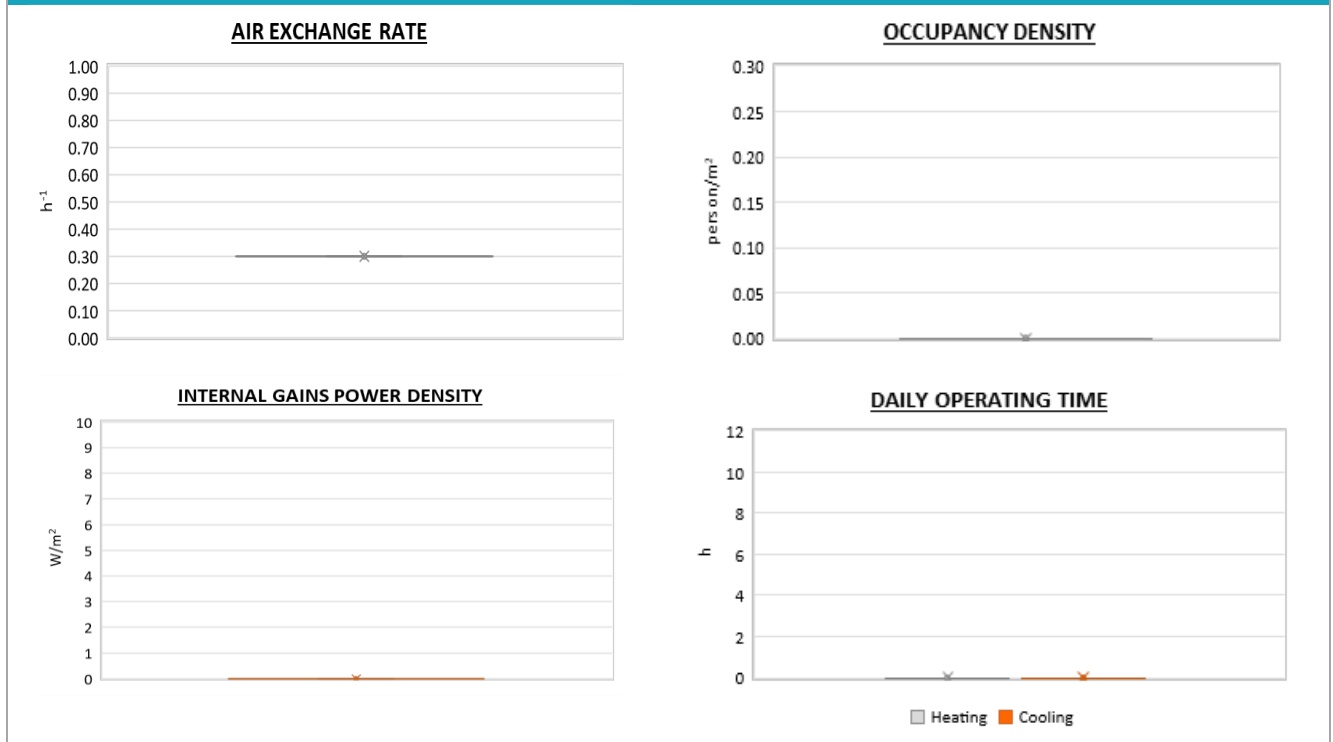

The data can be used for analysis, modeling, and research purposes, as long as it remains unaltered in its original form. Users are free to publish results based on the data, provided they credit the original source.

Region:	Trentino	Archetype code: RES_TEMP_ -1930_F_TN
Building category:	Temporary residential buildings	
Period of construction:	<1930	
Climatic zone:	F	
Number of records:		122

ADDITIONAL DATA								
	Data	Symbol	Unit of measure	Mean value	Standard deviation	Q1 (first quartile)	Median value	Q3 (third quartile)
THERMAL SYSTEMS	Heating efficiency or <i>COP</i>	$\eta_{H;gen}$ or $COP_{H;gen}$	-	This value has to be retrieved from suitable datasheets				
	Total heating power *	$P_{H;gen}$	kW	141	173	35	82	200
	Cooling efficiency or <i>EER</i>	$\eta_{C;gen}$ or $EER_{C;gen}$	-	This value has to be retrieved from suitable datasheets				
	Total cooling power *	$P_{C;gen}$	kW	26	21	16	21	25
	Temperature of DHW	ϑ_W	°C	-	-	-	-	-
	DHW system power *	$P_{W;gen}$	kW	180	453	34	86	200

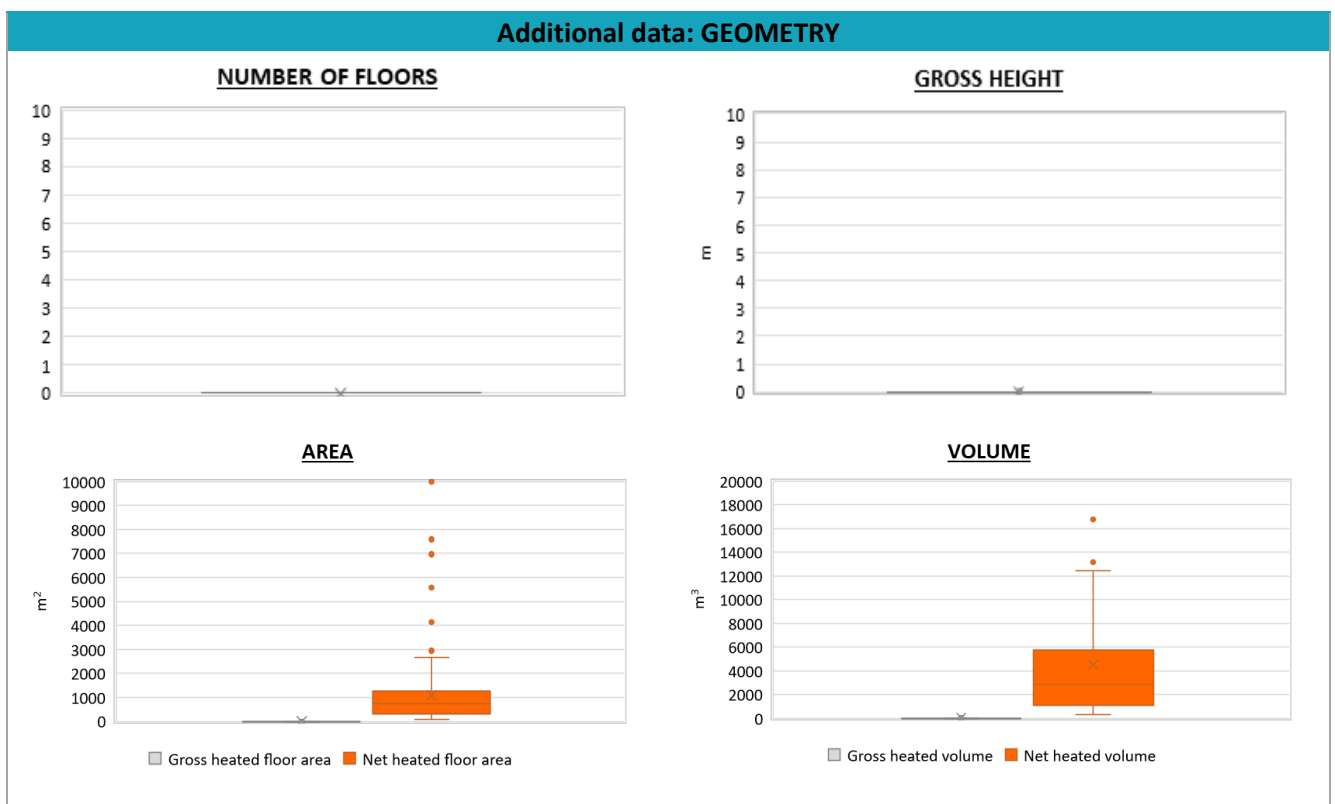


Region:	Trentino	Archetype code: RES_TEMP_ -1930_F_TN
Building category:	Temporary residential buildings	
Period of construction:	<1930	
Climatic zone:	F	
Number of records:		122

Additional data: other numerical variables that are not included in the archetype


DHW SUPPLY TEMPERATURE




SYSTEM POWER

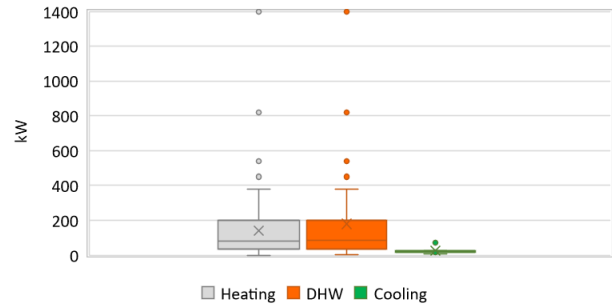


CO₂ EMISSION

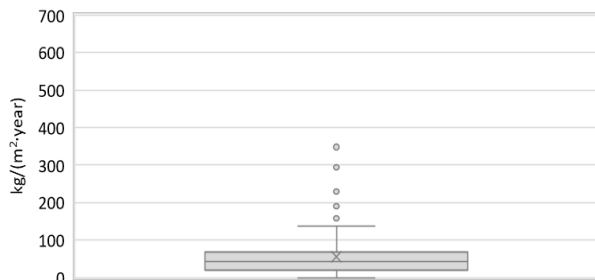

HEATING SYSTEM INSTALLATION YEAR

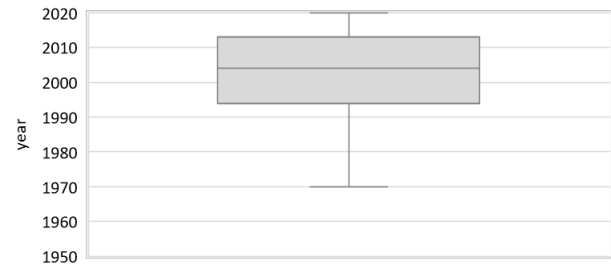

NON-RENEWABLE PRIMARY ENERGY USE

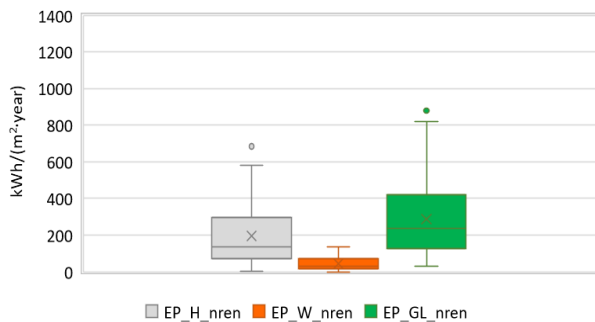

RENEWABLE PRIMARY ENERGY USE

